



UL US LISTED
 HOOD AND DUCT ACCESSORY
 65X3
 NFPA #96
 FILE No. MH16475

*The cut out dimension C should be 70% or less than the Duct Diameter for proper fit.

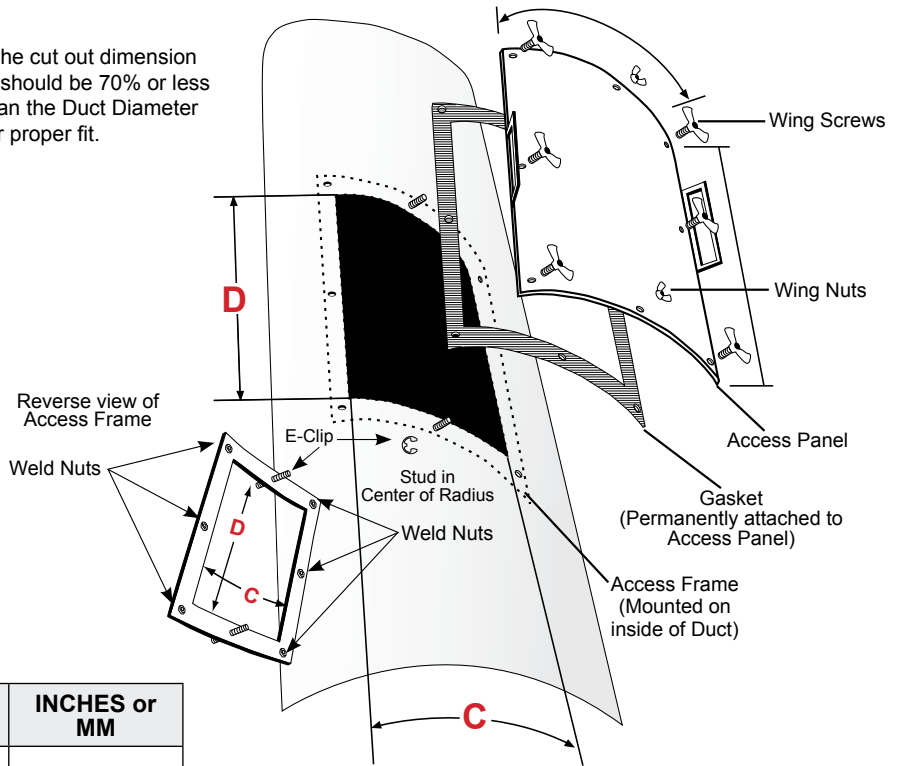

DIMENSIONS	SIZE	INCHES or MM
DUCT DIAMETER "A"		
*CUT OUT DIMENSION "C" "C" = 70% x "A" or LESS		
IF LESS THAN 70% GIVE SIZE		
CUT OUT DIMENSION "D"		

QUANTITY REQUIRED	

PANEL MATERIAL	Check One
GALVANIZED STEEL	<input type="checkbox"/>
STAINLESS STEEL 304	<input type="checkbox"/>
STAINLESS STEEL 316L	<input type="checkbox"/>

PANEL THICKNESS	Check One
.050" (1.3mm) S/S Models only	<input type="checkbox"/>
.060" (1.5mm)	<input type="checkbox"/>
.125" (3.2mm)	<input type="checkbox"/>

MOUNTING HARDWARE MATERIAL	Check One
ZINC PLATED STEEL	<input type="checkbox"/>
STAINLESS STEEL 304	<input type="checkbox"/>
STAINLESS STEEL 316L	<input type="checkbox"/>

Additional Notes

Date:	P.O. #	Account No:
Company Name:	Contact Name:	
Address:	City & State:	
Phone No:	E-mail:	Zip: